


00911" 295E2960

1/4

Fig. 1


Stability test, LB 931 (lyophilised)

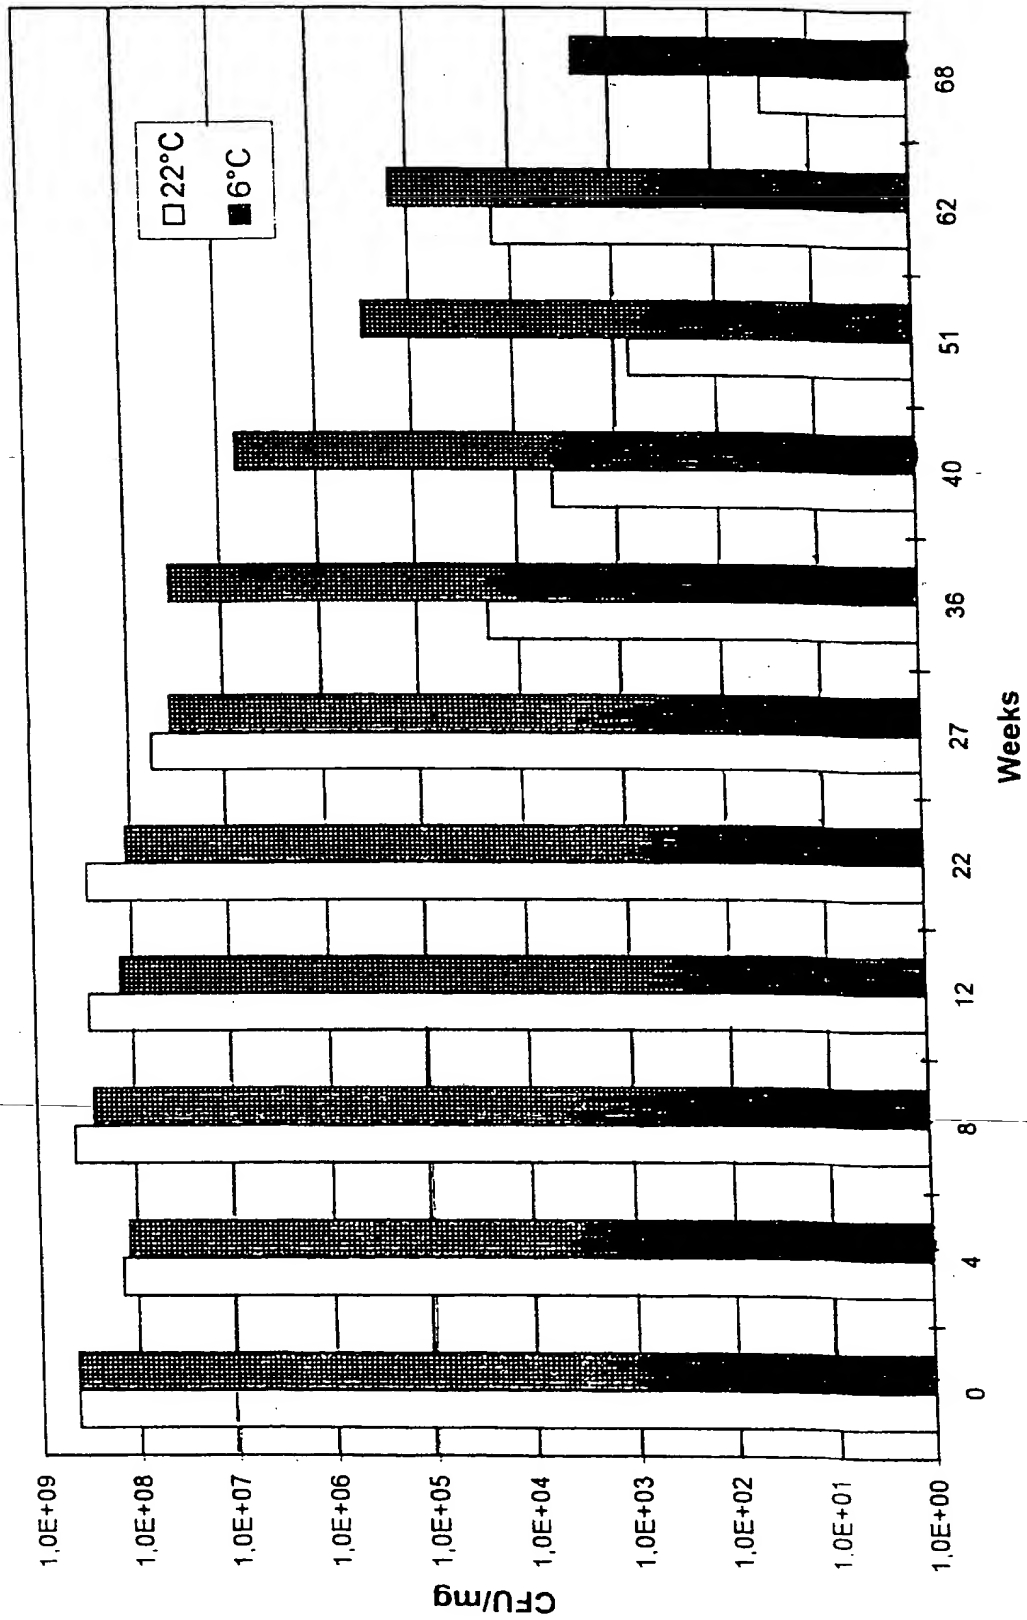

CONFIDENTIAL 295E2950

Fig. 2


Stability of Lb 931 impregnated on an absorbent article,
"Soft Normal"

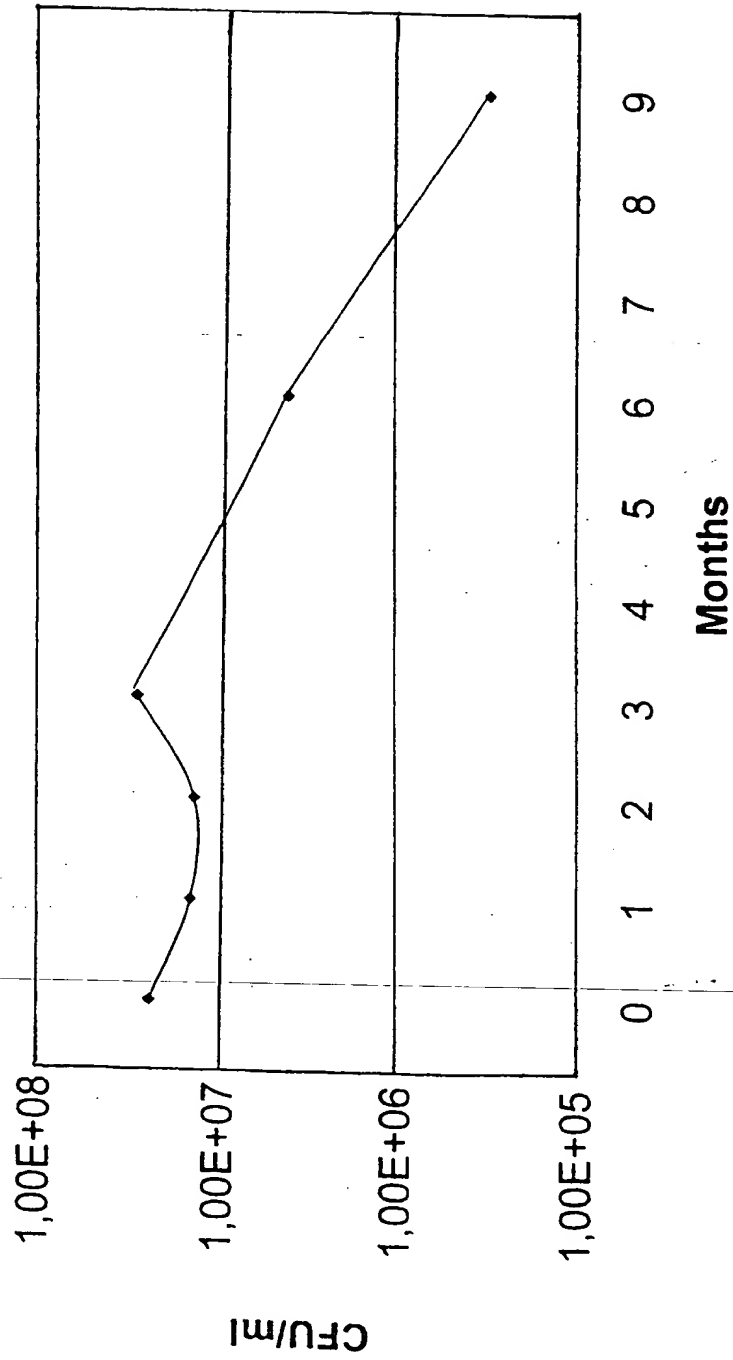

009111 295E2960

Fig. 3

Mean value of LB 931 during period day/night (urethra)

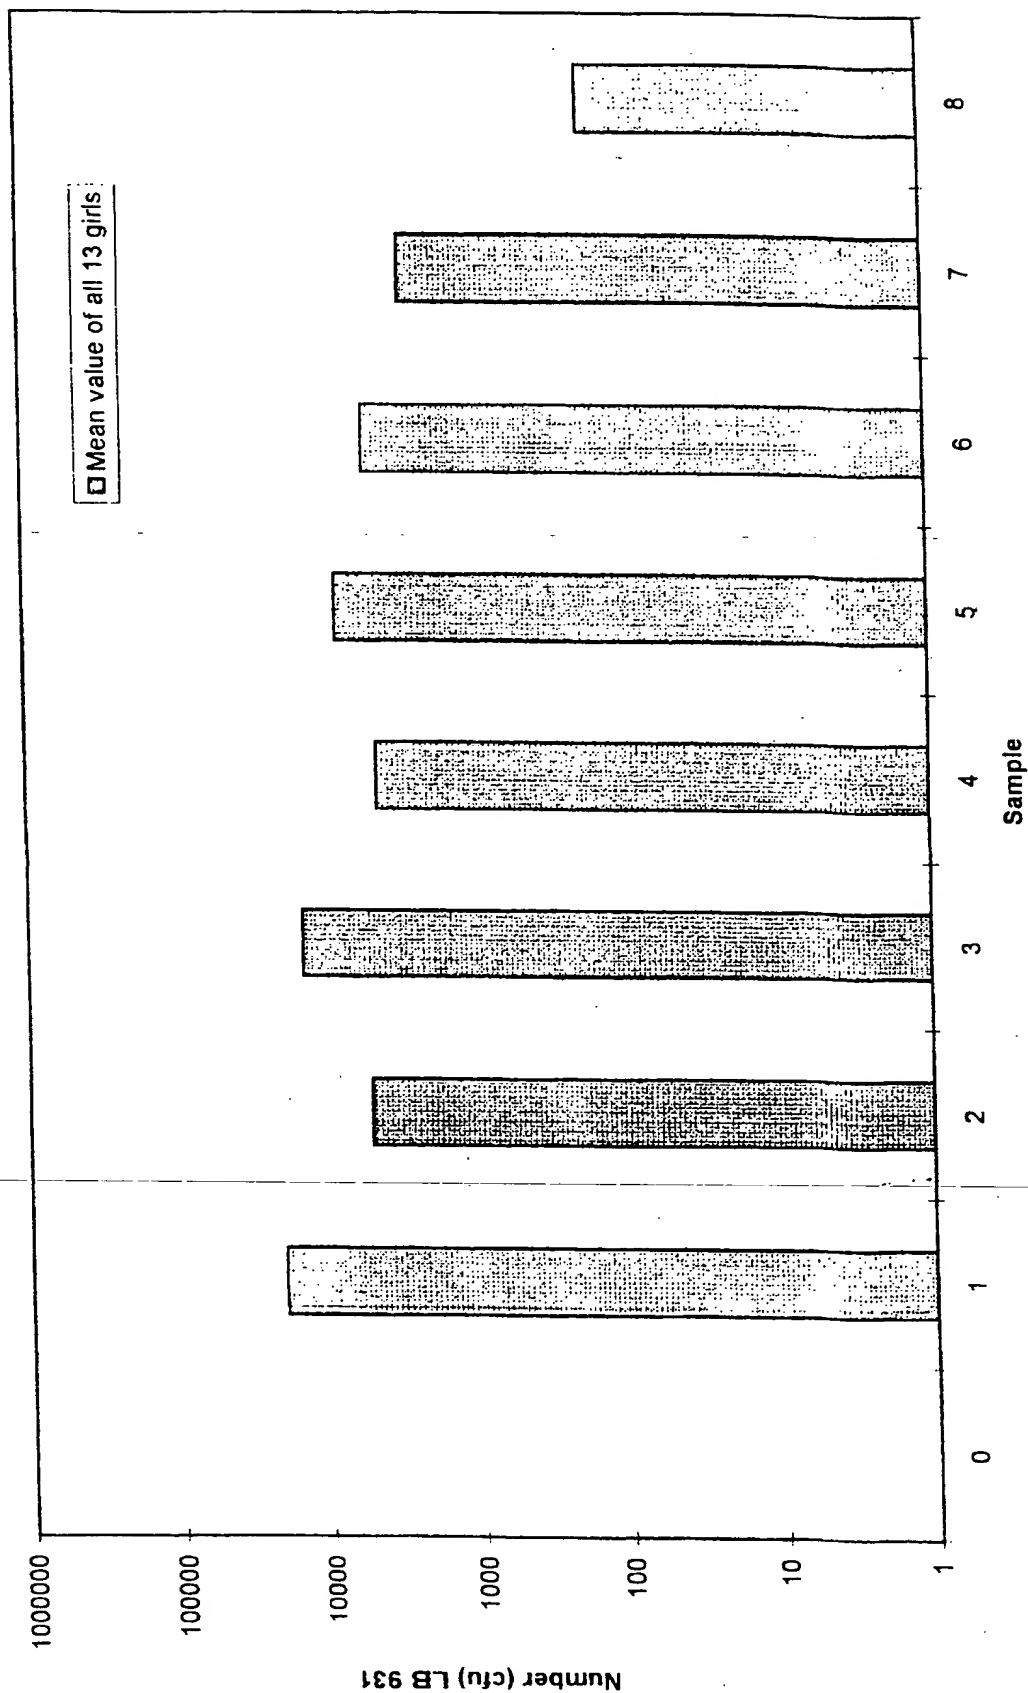

009T 2962960

WO 99/45099

4/4

09/623562
PCT/SE99/00336

Mean value of LB 931 during period day/night (perineum) Fig. 4

